


DZ-FLWR-AB-WHITEWIDOW

Sample ID: SA-251106-72280
Batch: 25303WW3GAB
Type: Finished Product - Inhalable
Matrix: Plant - Flower
Unit Mass (g):

Received: 11/10/2025
Completed: 11/21/2025

Client
Dazed
242 W Main St #364
Hendersonville, TN 37075
USA

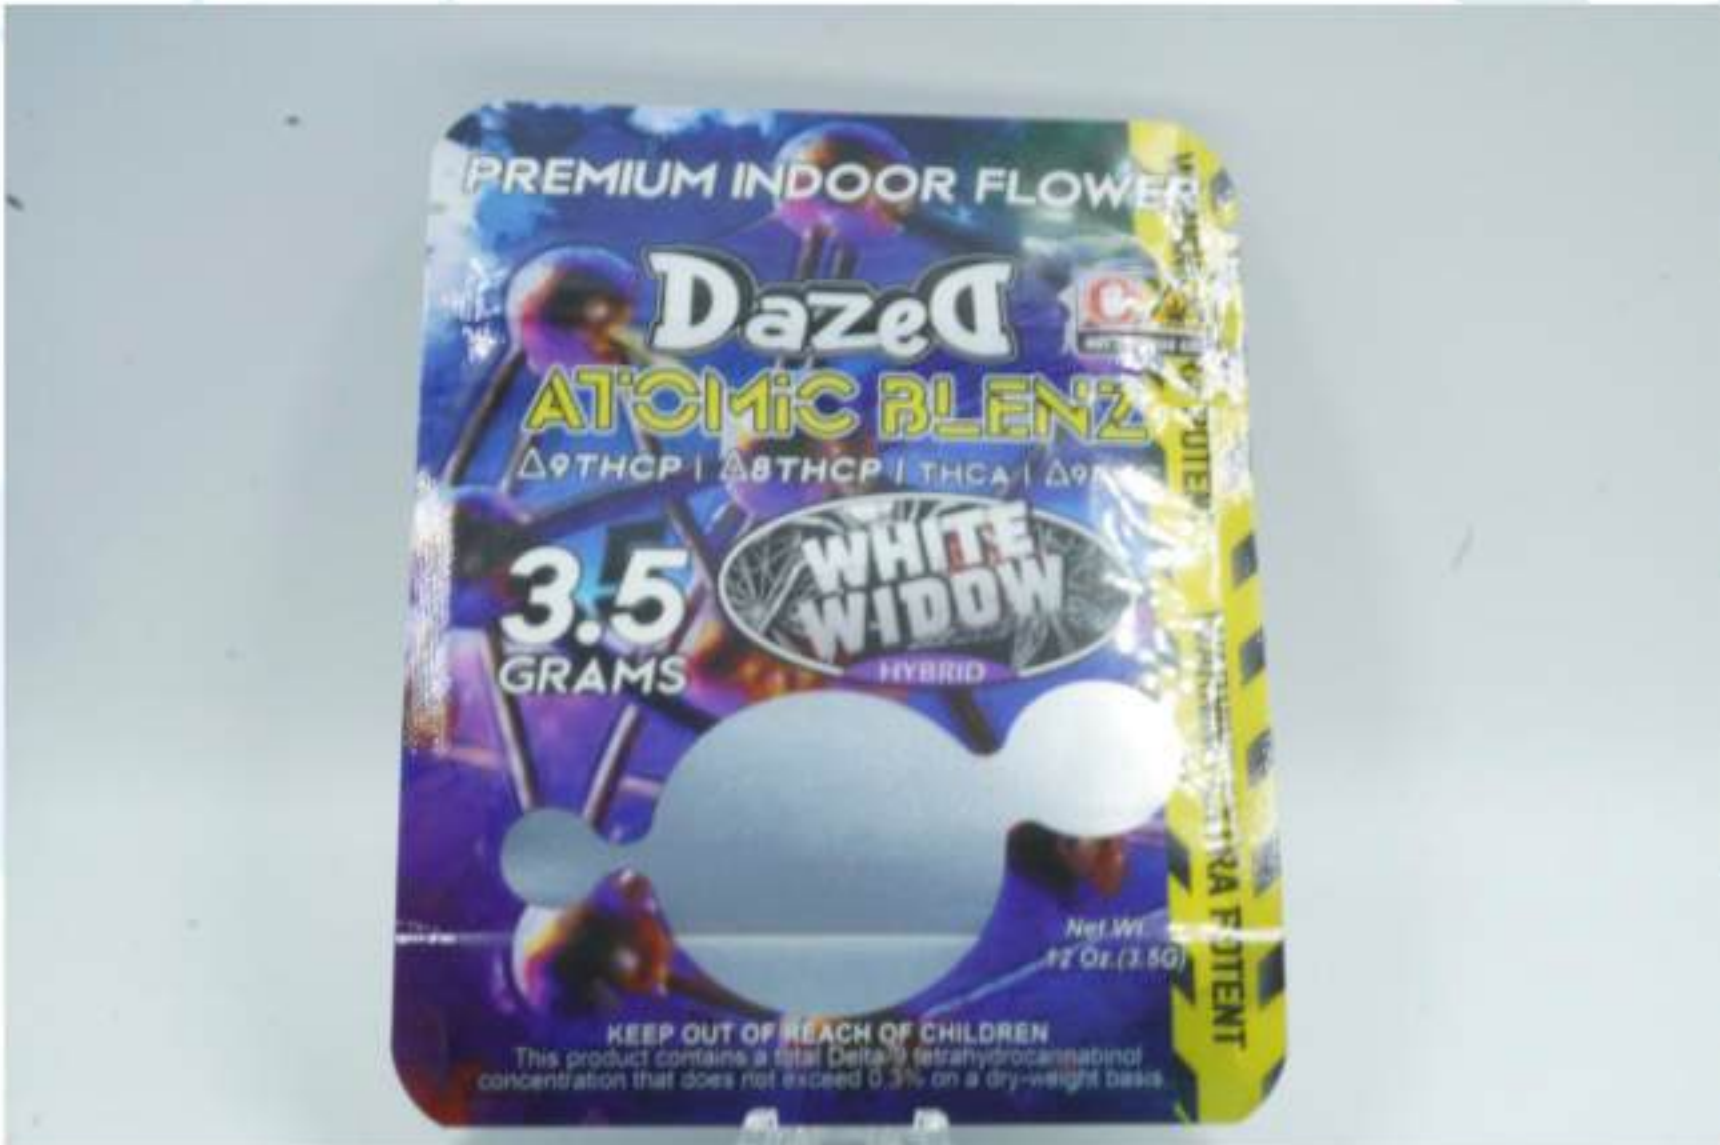

Summary

Test	Date Tested	Status
Cannabinoids	11/21/2025	Tested
Moisture	11/21/2025	Tested

0.0649 %	16.3 %	30.8 %	5.20 %	Not Tested	Yes
Total Δ9-THC	Δ8-THC	Total Cannabinoids	Moisture Content	Foreign Matter	Internal Standard Normalization



Generated By: Ryan Bellone
Commercial Director
Date: 11/21/2025



This product or substance has been tested by KCA Laboratories using validated testing methodologies and an ISO/IEC 17025:2017 accredited quality system. Values reported relate only to the product or substance tested. The reported result is based on a sample weight. Unless otherwise stated, results of tests performed on all quality control samples met criteria for acceptance established by KCA Laboratories. KCA Laboratories makes no claims as to the efficacy, safety or other risks associated with any detected or non-detected amounts of any substances reported herein. This Certificate of Analysis shall not be reproduced except in full, without the written approval of KCA Laboratories. KCA Laboratories can provide measurement uncertainty upon request.

DZ-FLWR-AB-WHITEWIDOW

Sample ID: SA-251106-72280
Batch: 25303WW3GAB
Type: Finished Product - Inhalable
Matrix: Plant - Flower
Unit Mass (g):

Received: 11/10/2025
Completed: 11/21/2025

Client
Dazed
242 W Main St #364
Hendersonville, TN 37075
USA


Cannabinoids by HPLC-PDA and GC-MS/MS

Analyte	LOD (%)	LOQ (%)	Result (% dry)	Result (mg/g dry)
CBC	0.00095	0.0028	0.438	4.38
CBCA	0.00181	0.0054	ND	ND
CBCV	0.0006	0.0018	ND	ND
CBD	0.00081	0.0024	0.101	1.01
CBDA	0.00043	0.0013	ND	ND
CBDB	0.00133	0.004	ND	ND
CBD-C8	0.00133	0.004	ND	ND
CBDH	0.00133	0.004	ND	ND
CBDP	0.00133	0.004	0.0151	0.151
CBDV	0.00061	0.0018	ND	ND
CBDVA	0.00021	0.0006	ND	ND
CBG	0.00057	0.0017	2.27	22.7
CBGA	0.00049	0.0015	5.84	58.4
CBL	0.00112	0.0033	ND	ND
CBLA	0.00124	0.0037	ND	ND
CBN	0.00056	0.0017	0.0601	0.601
CBNA	0.0006	0.0018	ND	ND
CBNP	0.00133	0.004	0.0299	0.299
CBT	0.0018	0.0054	0.232	2.32
Δ4,8-iso-THC	0.00133	0.004	0.250	2.50
Δ6a,10a-THC	0.00133	0.004	2.63	26.3
Δ8-iso-THC	0.00133	0.004	0.182	1.82
Δ8-THC	0.00104	0.0031	16.3	163
Δ8-THCB	0.00133	0.004	0.0155	0.155
Δ8-THC-C8	0.00133	0.004	ND	ND
Δ8-THCH	0.00133	0.004	ND	ND
Δ8-THCP	0.00133	0.004	0.0732	0.732
Δ8-THCV	0.00133	0.004	0.0390	0.390
Δ9-THC	0.00076	0.0023	0.0649	0.649
Δ9-THCA	0.00084	0.0025	ND	ND
Δ9-THCB	0.00133	0.004	ND	ND
Δ9-THC-C8	0.00133	0.004	ND	ND
Δ9-THCH	0.00133	0.004	ND	ND
Δ9-THCP	0.00133	0.004	1.82	18.2
Δ9-THCV	0.00069	0.0021	ND	ND
Δ9-THCVA	0.00062	0.0019	ND	ND
(6aR,9R)-Δ10-THC	0.00133	0.004	0.328	3.28
(6aR,9S)-Δ10-THC	0.00133	0.004	0.192	1.92
exo-THC	0.00133	0.004	ND	ND
(6aR,9R,10aR)-HHC	0.00133	0.004	ND	ND
(6aR,9S,10aR)-HHC	0.00133	0.004	ND	ND
Total Δ9-THC			0.06487	0.649
Total			30.8	308

ND = Not Detected; NR = Sample matrix interference present which may affect accuracy of results; NT = Not Tested; UA = Unsuitable for Analysis; NR = (Spike) Not Recoverable; LOD = Limit of Detection; LOQ = Limit of Quantitation; RL = Reporting Limit; Δ = Delta; Total Δ9-THC = Δ9-THCA * 0.877 + Δ9-THC; Total CBD = CBDA * 0.877 + CBD;



Generated By: Ryan Bellone
Commercial Director
Date: 11/21/2025

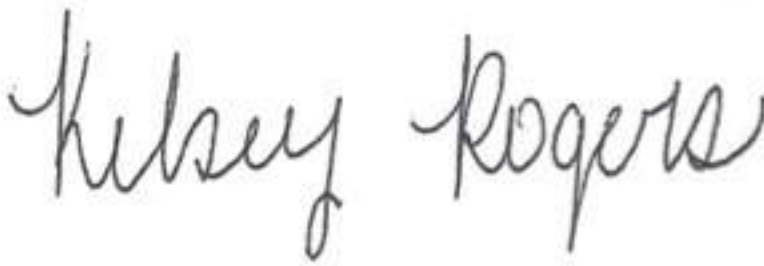

Tested By: Kelsey Rogers
Scientist
Date: 11/21/2025



ISO/IEC 17025:2017 Accredited
Accreditation #108651



This product or substance has been tested by KCA Laboratories using validated testing methodologies and an ISO/IEC 17025:2017 accredited quality system. Values reported relate only to the product or substance tested. The reported result is based on a sample weight. Unless otherwise stated, results of tests performed on all quality control samples met criteria for acceptance established by KCA Laboratories. KCA Laboratories makes no claims as to the efficacy, safety or other risks associated with any detected or non-detected amounts of any substances reported herein. This Certificate of Analysis shall not be reproduced except in full, without the written approval of KCA Laboratories. KCA Laboratories can provide measurement uncertainty upon request.